

Grills & Insulated Jackets


MODEL	CUTOUT DIMENSIONS				NOTCH N	POWER			GAS LINE
	W	D	H	YES		NO	AMPS		
ALXE-30	28-1/2"	23"	10-1/4"	7/8"	✓		1.44 / 0.91	✓	
ALXE-36	34-1/2"	23"	10-1/4"	7/8"	✓		1.44 / 0.91	✓	
ALXE-42	40-1/2"	23"	10-1/4"	7/8"	✓		1.44 / 0.91	✓	
ALXE-56	54-1/2"	23"	10-1/4"	7/8"	✓		1.44 / 0.91	✓	
AIJ-30	33-1/4"	24-5/8"	11-1/4"	7/8"	✓		◆	✓	
AIJ-36	39-1/4"	24-5/8"	11-1/4"	7/8"	✓		◆	✓	
AIJ-42	45-1/4"	24-5/8"	11-1/4"	7/8"	✓		◆	✓	
AIJ-56	59-1/4"	24-5/8"	11-1/4"	7/8"	✓		◆	✓	

Note 1: All grills require a 1/2" NPT gas connection with 4" WC for natural gas and 10" Wc for liquid propane.

Note 2: All power supplies are 115 VAC-1Ø-60 Hz. GFCI Receptacle recommended.

◆ Note: Power requirement as stated on the corresponding grill (NOT DUE TO THE AIJ JACKET BY ITSELF).

Dimensions and specifications are subject to change without notice. Please visit our website for the latest updates.

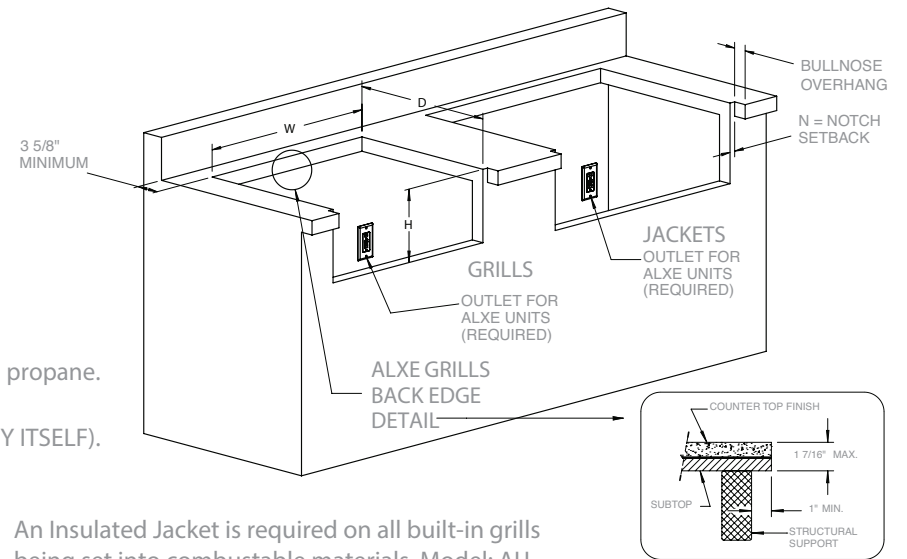

An Insulated Jacket is required on all built-in grills being set into combustible materials. Model: AIJ

Countertop Accessories

MODEL	CUTOUT DIMENSIONS				NOTCH N	SETBACK S	POWER			GAS LINE	WATER LINE	DRAIN LINE
	W	D	H	YES			NO	AMPS				
AXEVP	21-1/2"	22-1/2"	10-1/4"	1-3/8"			✓		✓			
AXEVP-T10	4-1/2"	4-1/2"			1-5/8" ❖		✓			3/8" Ⓢ		
AXESB2/AXESZ	13-1/4"	23"	10-1/4"	1/2"			✓		✓			
AXEFW	13-1/4"	23"	10-1/4"	1/2"			✓					
ADT-14	13-1/4"	23"	9-1/4"	1/2"			✓			1/2"	1"	
ADT-24	23-1/4"	23"	10-1/4"	1/2"			✓				1"	
ADT-30	28-1/2"	23"	10-1/4"	3/4"			✓			1/2"	1" + 2"	
AGBC-14	13-1/4"	23"	9-1/4"	1/2"			✓			1/2"	1"	
AGBC-24	23-1/4"	23"	10-1/4"	1/2"			✓				1"	
AGBC-30	28-1/2"	23"	10-1/4"	7/8"			✓		0.08		1-1/2"	
ASK-T	13-1/4"	23"	10-1/4"	1/2"			✓			1/2"	1"	
APS-30	27-1/2"	8-3/4"	9-1/4"	1-3/8"			✓					
APS-30P	27-1/2"	15-1/4"	9-1/4"	1-3/8"			✓					

Note 1: All burners require a 1/2" NPT gas connection with 4" WC for a natural gas and 10" Wc for liquid propane.


Note 2: All water lines are 1/8" compression or 1/2" NPSN unless otherwise shown.

Note 3: All drains sizes as shown are NPSM standard.

Note 4: All power supplies are 115 VAC-1Ø-60 Hz. GFCI receptacle recommended.

❖ Note: The AXEVP-T10 pot filler tower requires a minimum setback as shown (OVER AND UNDER THE COUNTER) from the back wall for proper hardware installation.

Ⓢ Note: The AXEVP-T10 pot filler tower requires a 3/8" compression water line and comes with a 72" long copper line for field connection.

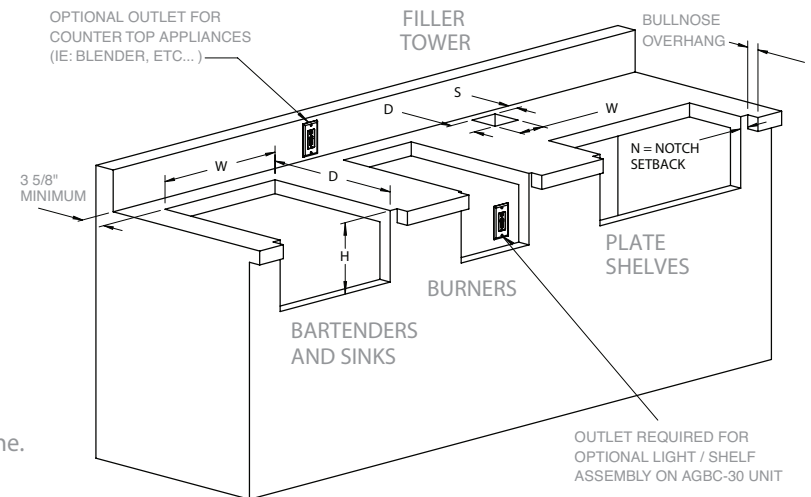

For additional details visit:
www.alfrescogrills.com